



M:\cadd\SFW\DW\WATER SERVICE STAND\Pres Vac Breaker-Stand Setting.dwg Last Modified: May 01, 2009 - 9:21am Plotted on: Jul 10, 2009 - 2:57pm By: pb

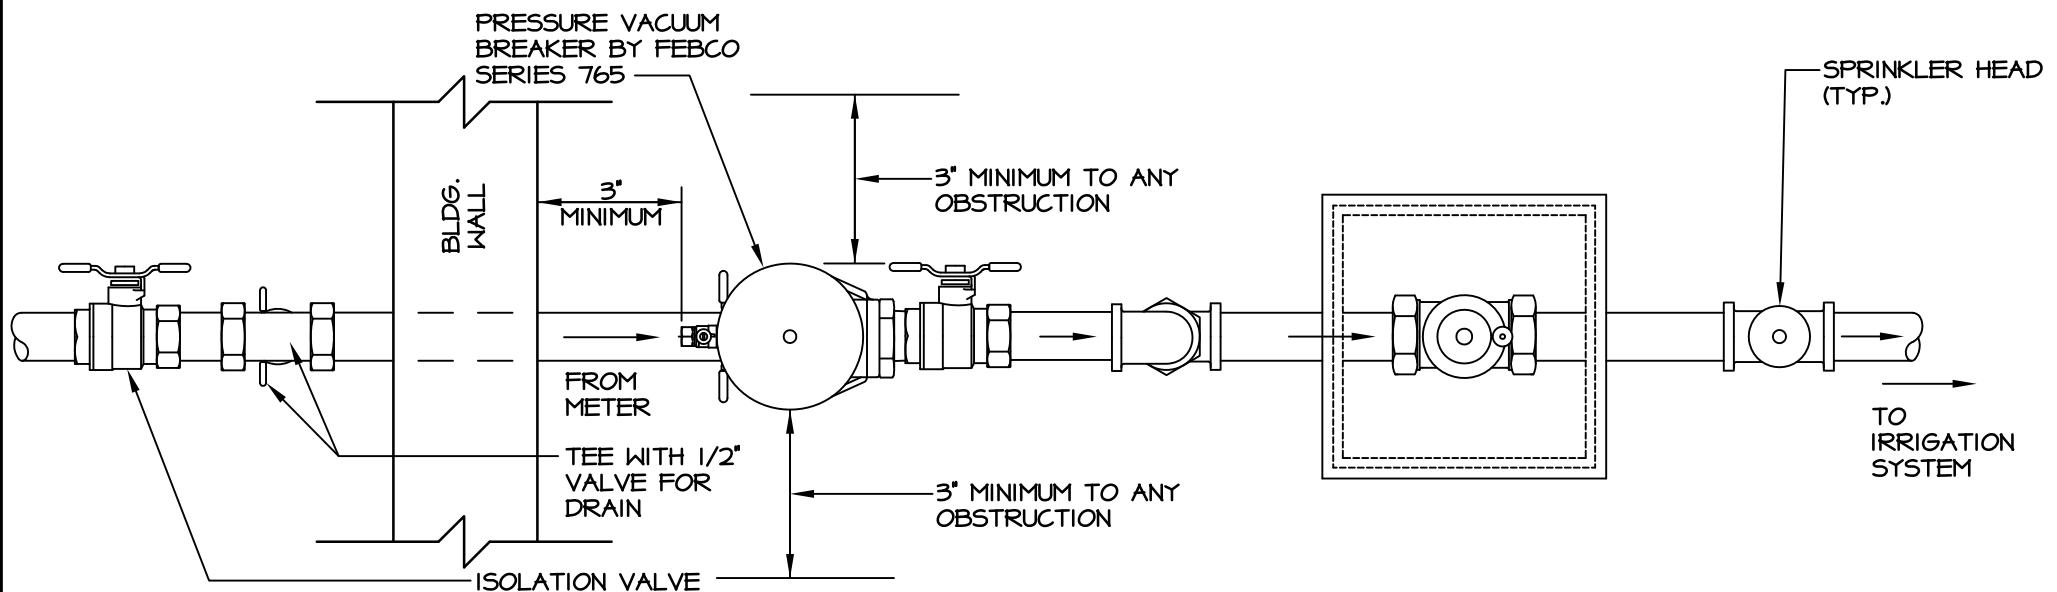

**PLAN**

NTS

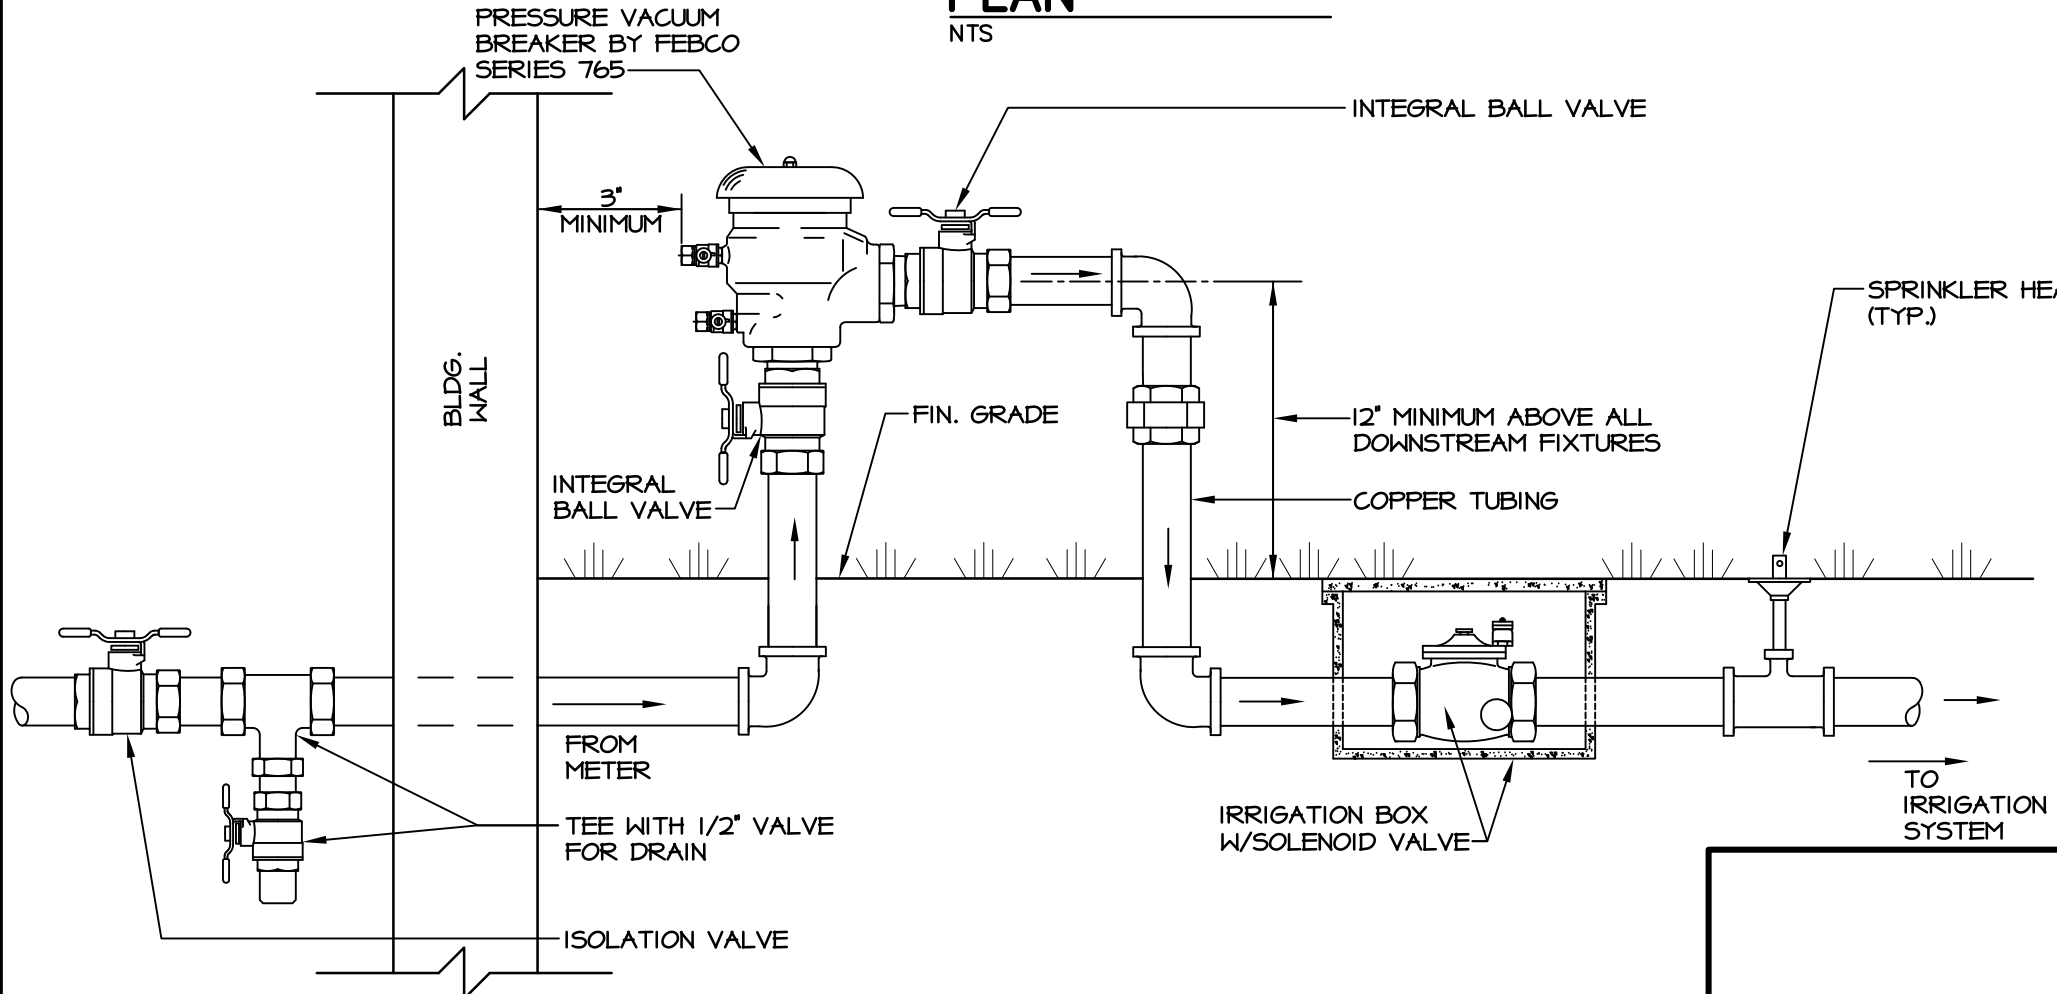

**ELEVATION**

NTS

**NOTIFICATION TO WATER DISTRICT:**

THE PLUMBER SHALL NOTIFY THE SUPERINTENDENT OF THE SOUTH FARMINGDALE WATER DISTRICT AT (516) 249-3330 A MINIMUM OF 24 HOURS PRIOR TO THE COMMENCEMENT OF ANY WORK.

**NOTES:**

1. ALL IRRIGATION CONNECTIONS ON THE DOMESTIC WATER SERVICE SHALL BE DOWNSTREAM FROM THE WATER METER.
2. ALL INSTALLATIONS SHALL BE IN ACCORDANCE WITH ALL APPLICABLE NASSAU COUNTY, NEW YORK STATE HEALTH DEPARTMENT AND SOUTH FARMINGDALE WATER DISTRICT REQUIREMENTS.
3. PVB VALVE SHALL BE INSTALLED WHERE IT IS ACCESSIBLE FOR PERIODIC DISASSEMBLY, INSPECTION & TESTING.
4. PVB ASSEMBLY MUST BE INSTALLED IN A LOCATION THAT IS NOT SUBJECT TO FLOODING AND/OR EXCESSIVE PRESSURE INCREASES. THE OWNER MUST DRAIN LINE TO GUARD AGAINST FREEZING OR INSTALL FREEZE PROTECTION PVB.
5. PVB VALVES SHALL BE INSTALLED OUTSIDE AND AT A MINIMUM OF 12" ABOVE HIGHEST OUTLET SERVED.
6. SOUTH FARMINGDALE WATER DISTRICT HAS STANDARDIZED ON FEBCO SERIES 765. ALTERNATE PVB VALVES MAY BE UTILIZED IF APPROVED BY THE SOUTH FARMINGDALE WATER DISTRICT PRIOR TO PURCHASE & INSTALLATION.
7. THE PLUMBER SHALL BE LICENSED BY THE TOWN OF OYSTER BAY AND SHALL BE APPROVED BY THE SOUTH FARMINGDALE WATER DISTRICT.

**SOUTH FARMINGDALE  
WATER DISTRICT**

**PRESSURE VACUUM BREAKER  
STANDARD SETTING 3/4" - 2"**

STANDARD DETAIL  
**EXTERIOR INSTALLATION**  
(EXISTING OR NEW SERVICE)

APPROVED BY THE BOARD OF COMMISSIONERS

APPROVED BY: \_\_\_\_\_ DATE: \_\_\_\_\_